


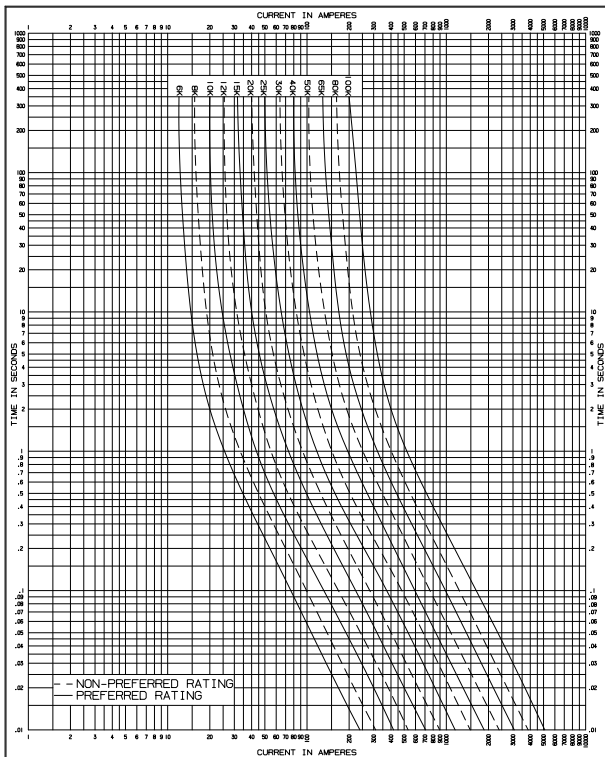

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DATE 02-9-00 DATE 19892
REPLACES 02/70 REV 00 REG NO. 19892
DWG NO. 42 39637 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
FOR TYPE EEI-NEMA TYPE K-SILVER


Tests made at 240 Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1982)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-4
Page 1 of 2

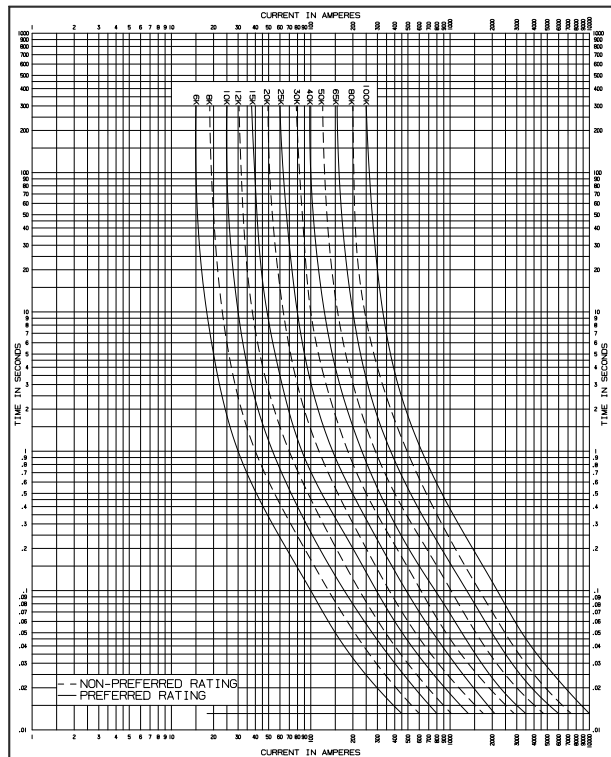

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DATE 02-9-00 DATE 19892
REPLACES 02/70 REV 00 REG NO. 19892
DWG NO. 42 39637 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
FOR TYPE EEI-NEMA TYPE K-SILVER

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1982)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-4
Page 2 of 2