

COOPER POWER SYSTEMS DIVISION
COMPONENTS & PROTECTIVE EQUIPMENT


TIME-CURRENT CHARACTERISTIC CURVES


MINIMUM MELT TIME-CURRENT CHARACTERISITC CURVES
5.5kV X-LIMITER FULL RANGE FUSE

DRAWN BY **RJC** CHK'D
DATE **1-15-96** DATE
REPLACES **9/90** REV **01** REQ. NO.
DWG. NO. **TCC324 M**

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-107
Page 1

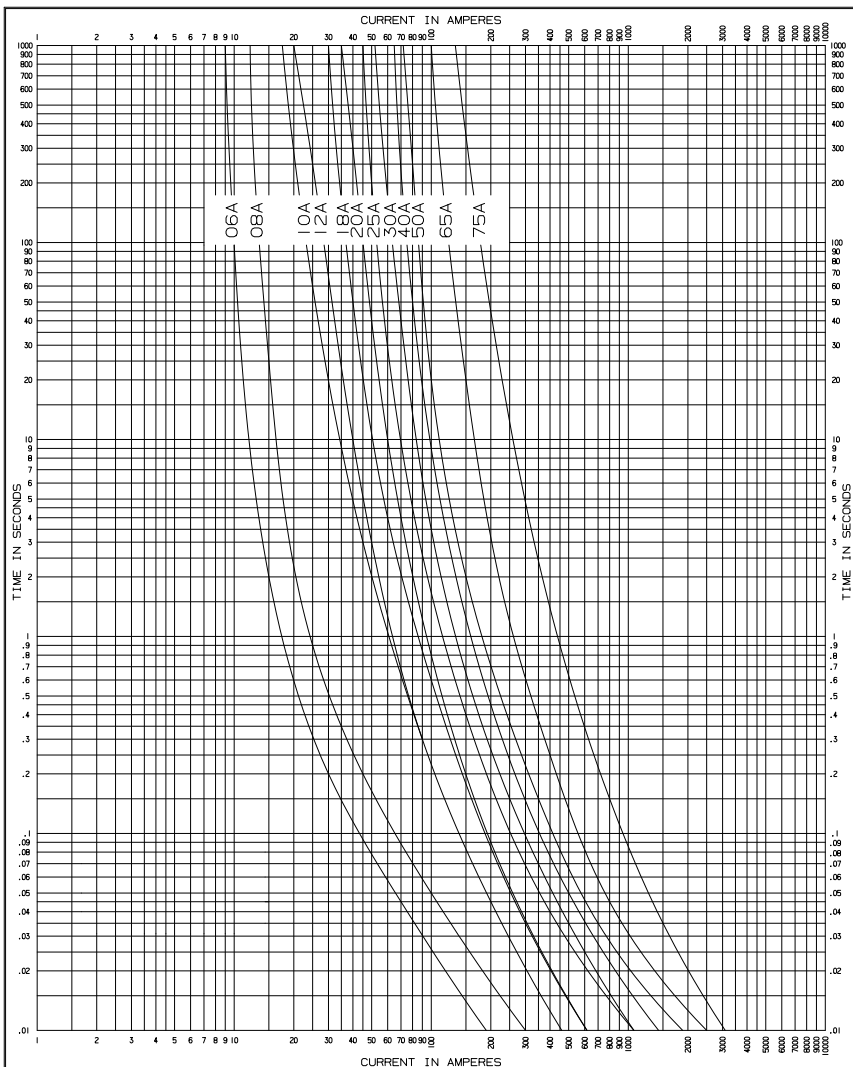

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES 5.5kV X-LIMITER FULL RANGE FUSE	
DRAWN BY	RJC	CHK'D	
DATE	1-15-96	DATE	
REPLACES	9 / 90 REV 01	REQ. NO.	
DWG NO.	TCC324 C	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
 R240-91-107
 Page 2