

COOPER POWER SYSTEMS DIVISION  
COMPONENTS & PROTECTIVE EQUIPMENT

DRAWN BY ALJ CHK'D  
DATE 7/8/96 DATE  
REPLACES 06/96 REV 02 REQ. NO.  
DWG NO. CT TCC328 M 00

# TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT

CAT.NO. 15FXXXHDIA X-LIMITER HINGE FUSE FITS S&C SMD20 MTG


Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Date  
R240-91-150  
Page 1

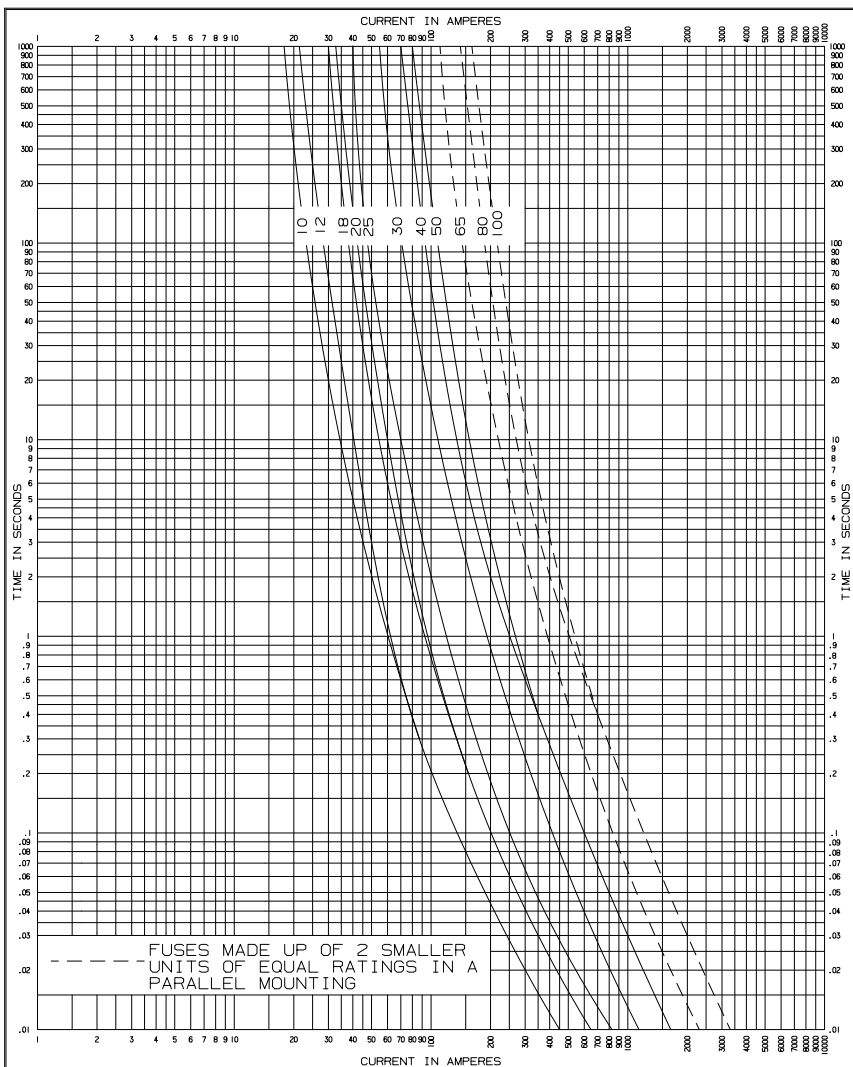

COOPER POWER SYSTEMS DIVISION  
COMPONENTS & PROTECTIVE EQUIPMENT

DRAWN BY ALJ CHK'D  
DATE 7/8/96 DATE  
REPLACES 06/96 REV 02 REQ. NO.  
DWG NO. CT TCC328 C 00

# TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR

CAT.NO.15FXXXHDIA X-LIMITER HINGE FUSE FITS S&C SMD20 MTG

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Date  
R240-91-150  
Page 2