



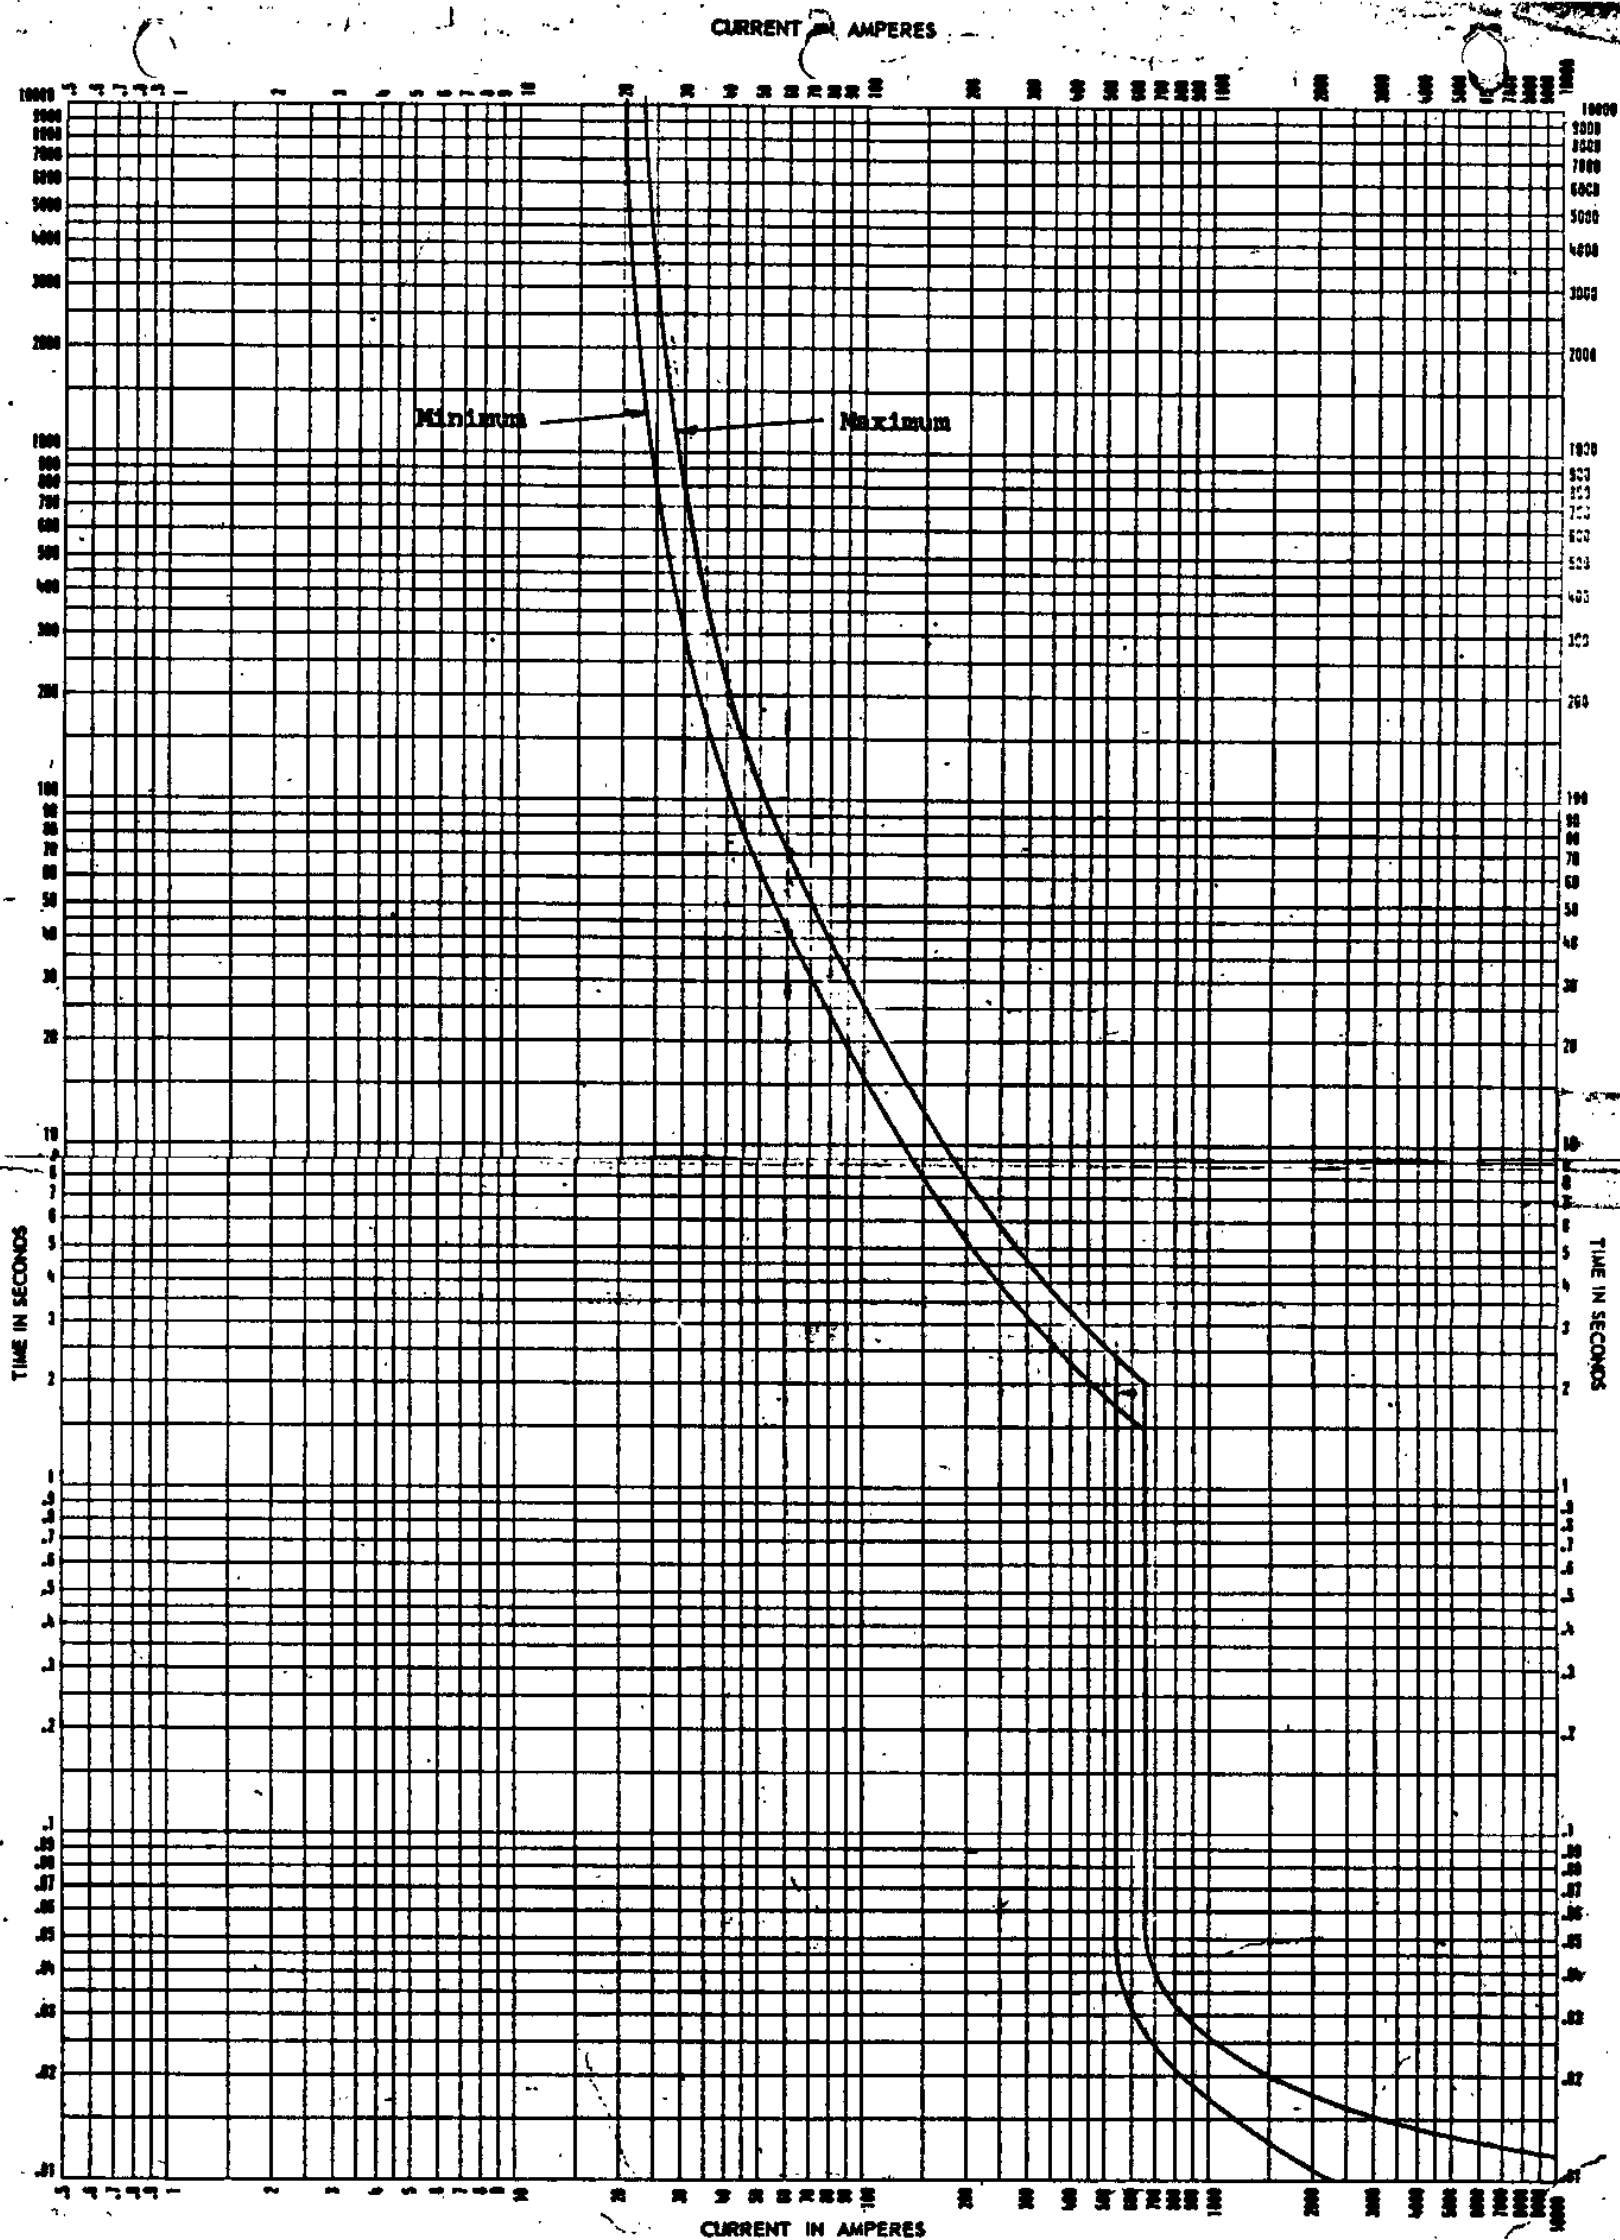


TIME-CURRENT CHARACTERISTIC CURVES, 20 Ampere, 3 Pole "HF" Frame
Circuit Breaker, 60 cycles, 600 Volts AC, 40C Ambient

ORDER NO. _____
TEST NO. 7289 FILE NO. _____
DWN. BY *John P. ...* DATE 12-31-64
NO. **TD-4724** REV. 0

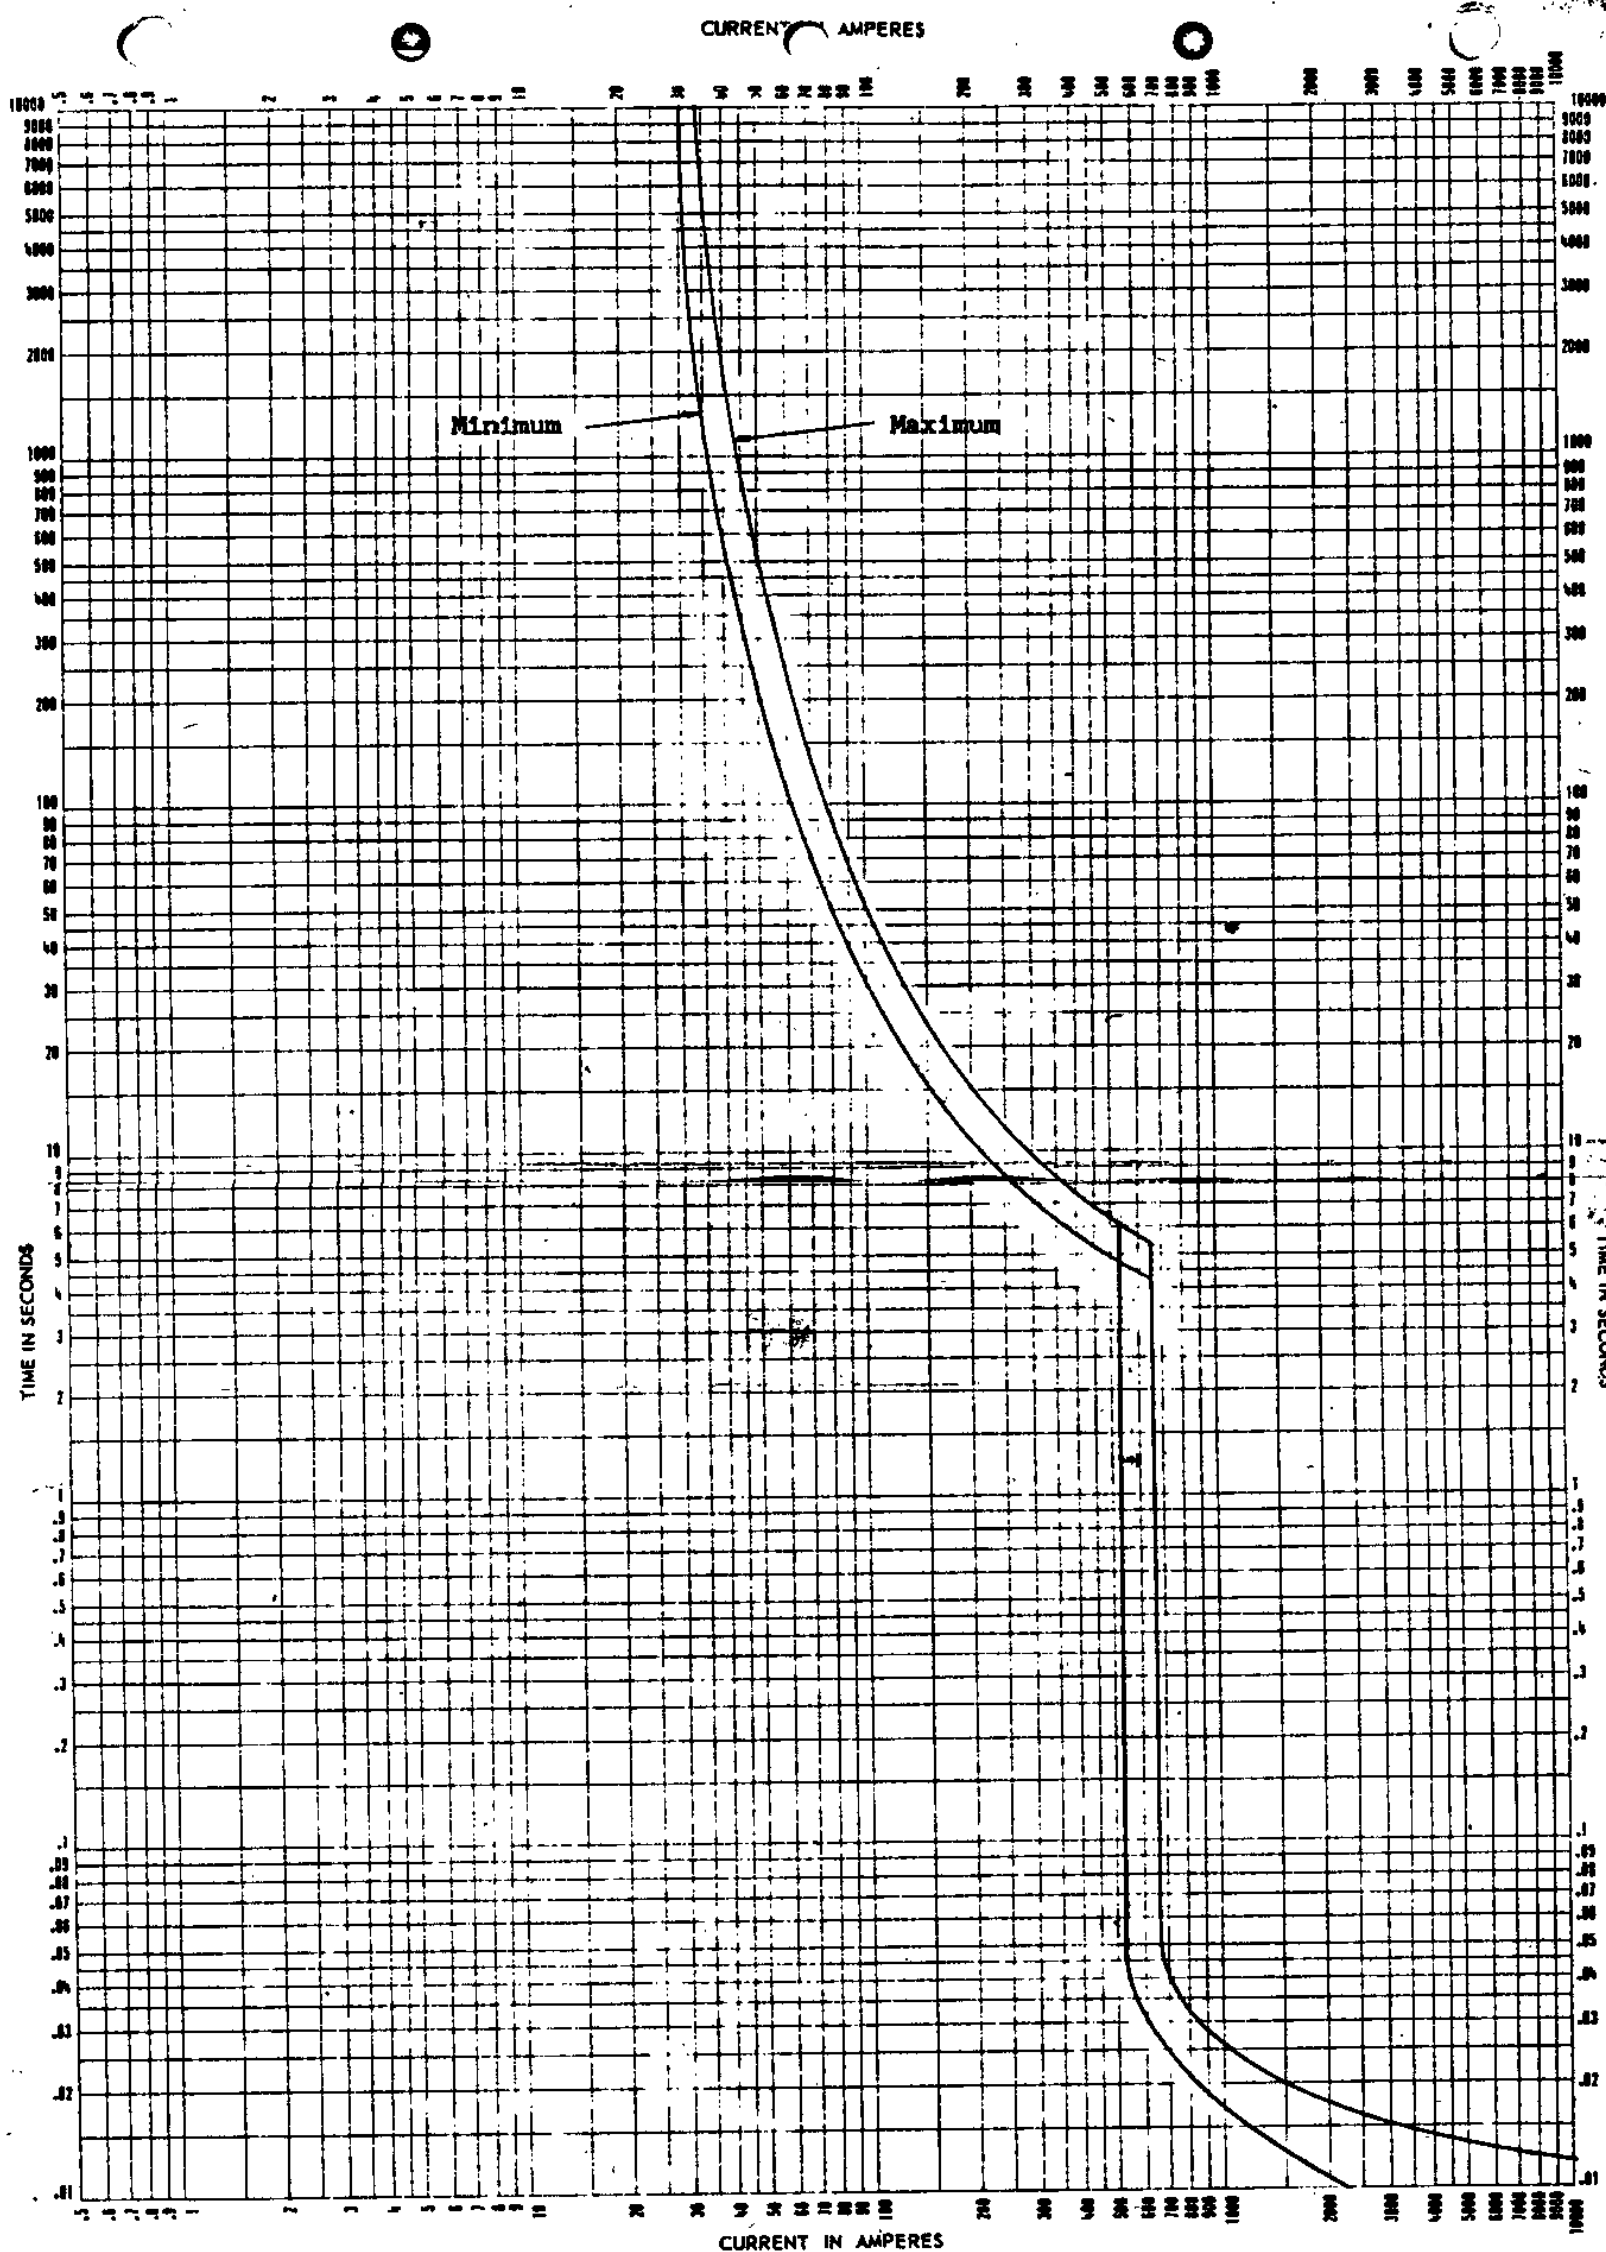

TIME-CURRENT CHARACTERISTIC CURVES 30 Ampere, 3 Pole "HP" Frame Circuit Breaker, 60 Cycles, 600 Volts AC, 40C Ambient	ORDER NO. _____
_____	TEST NO. 7289 FILE NO. _____
_____	DWN. BY <i>John R. Rindgen</i> DATE 12-31-64
_____	NO. TD-4725 REV. 0

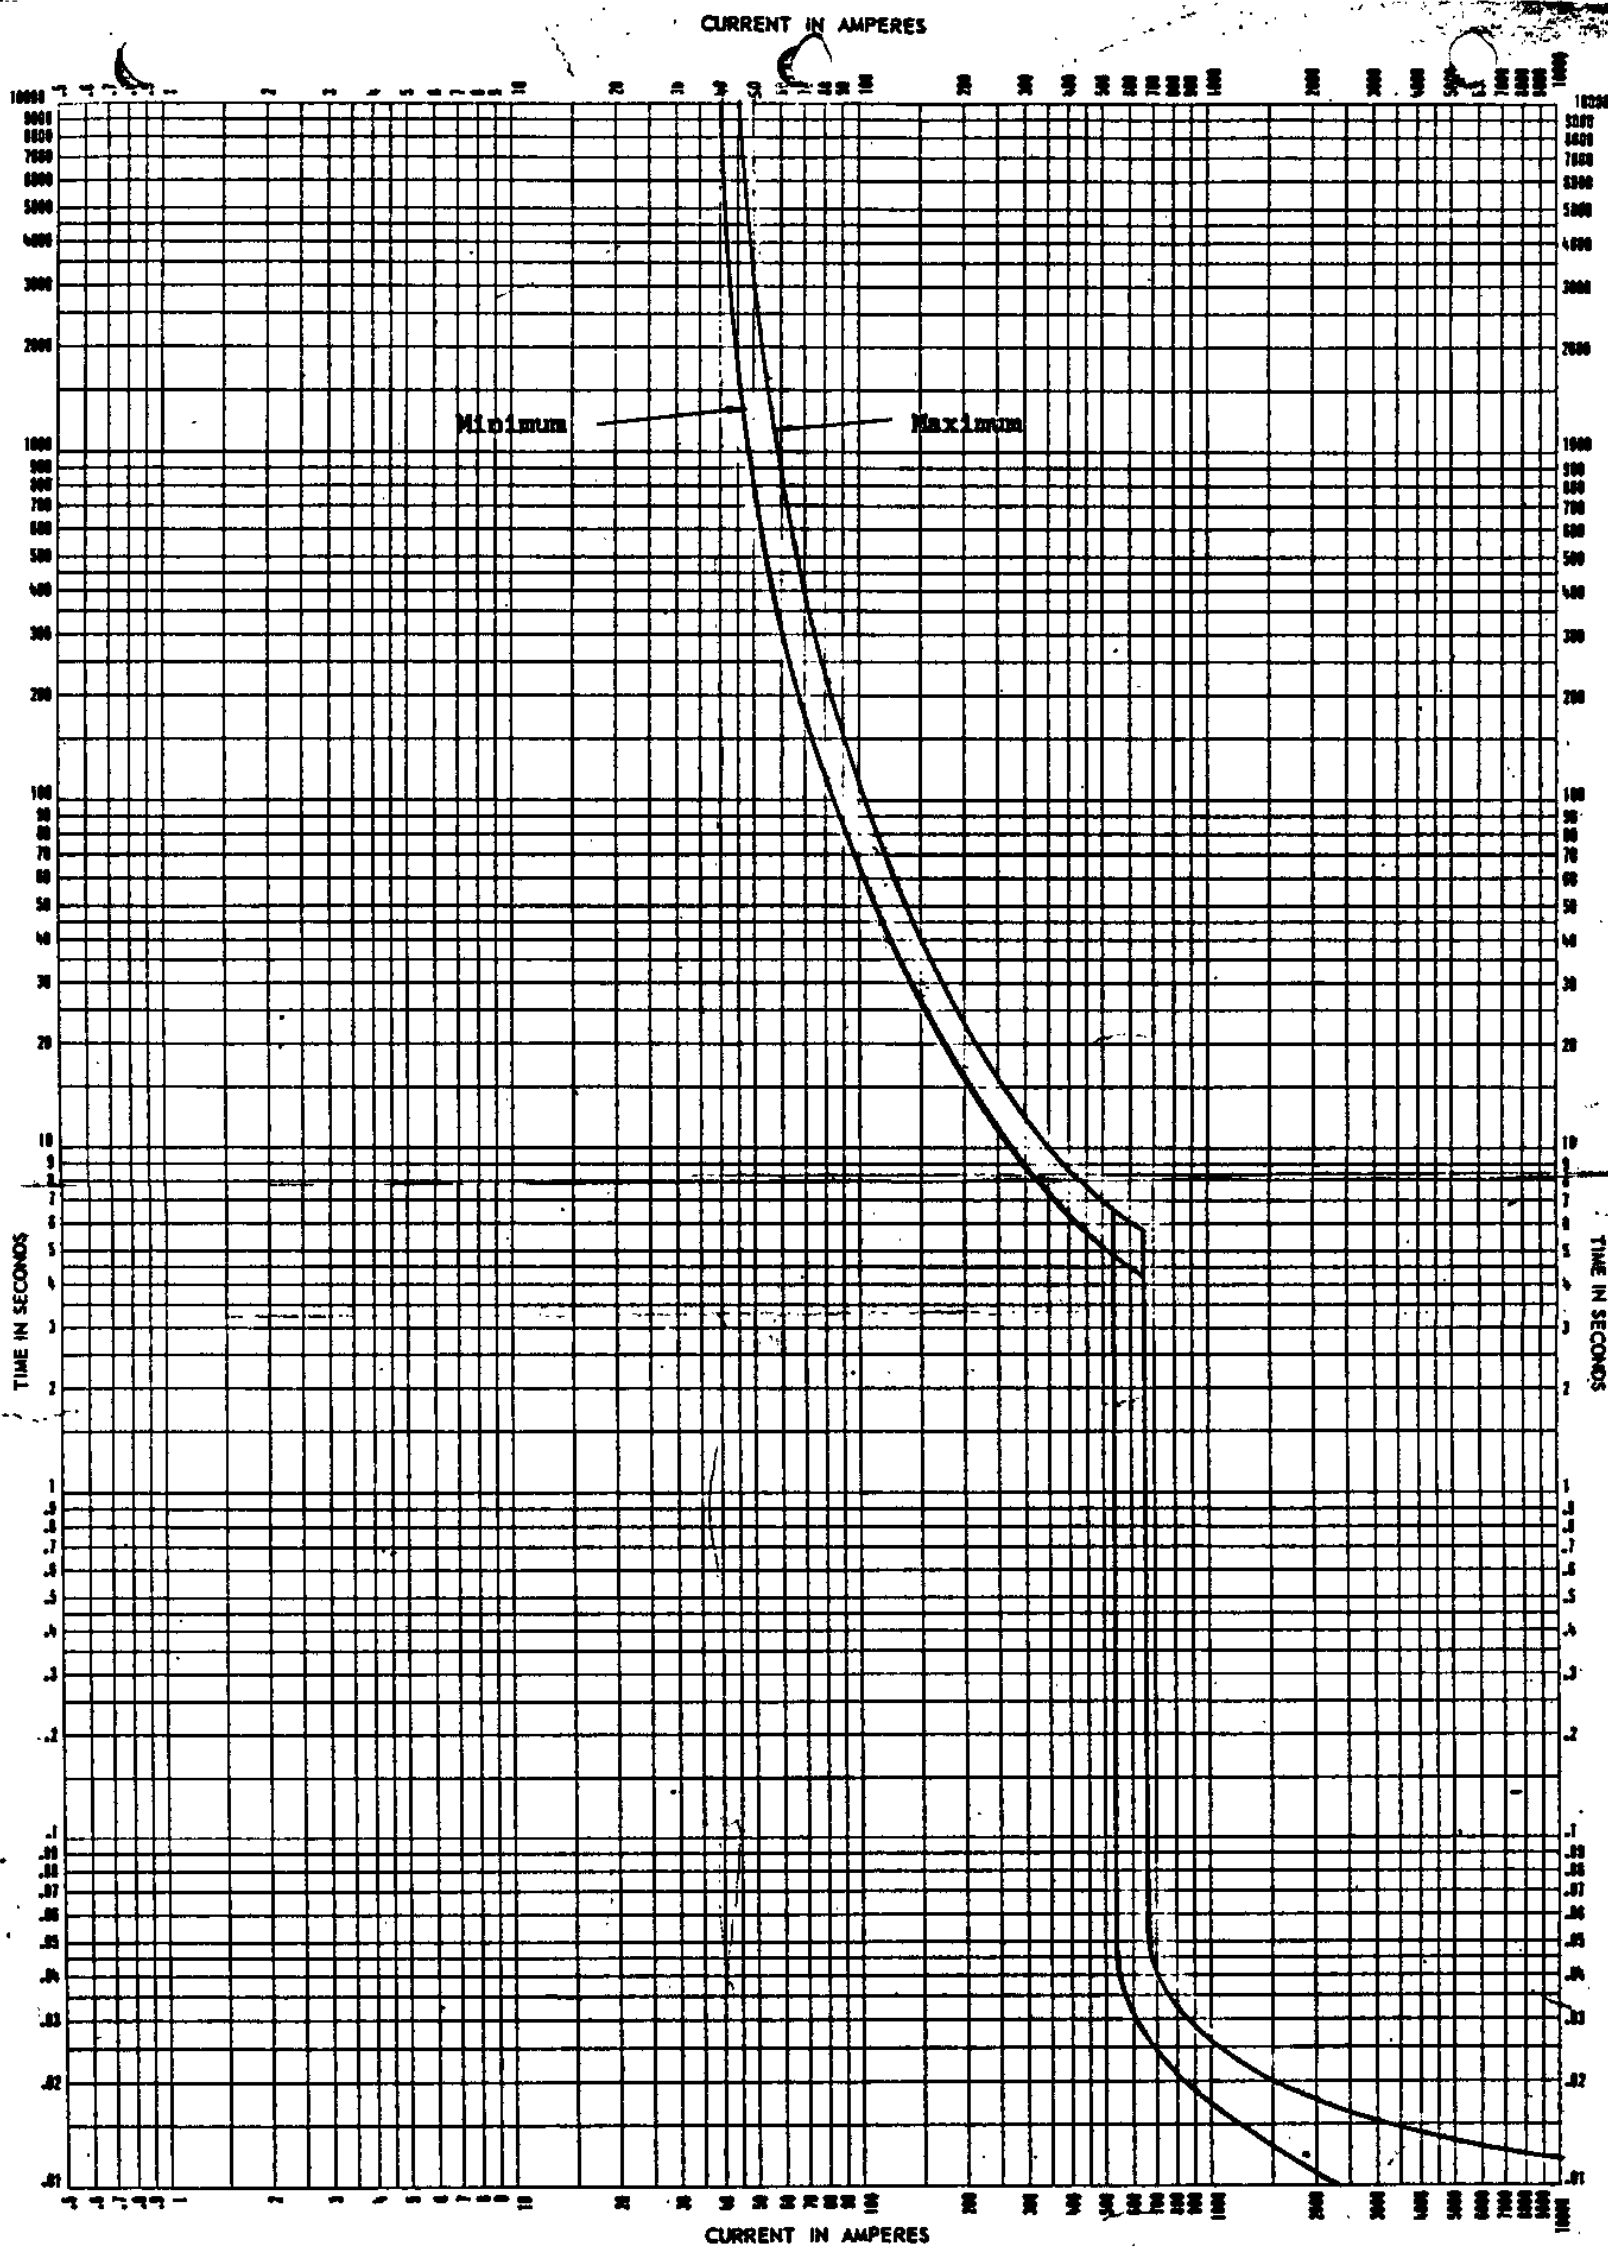

TIME-CURRENT CHARACTERISTIC CURVES 40 Ampere, 3 Pole "HP" Frame
Circuit Breaker, 60 Cycles, 600 Volts AC, 40C Ambient

ORDER NO. _____
TEST NO. 7289 FILE NO. _____
DWN. BY John R. Bandy DATE 12-31-64
NO. TD-4726 REV. 0