


INPUT 208Y/120 VOLTS 3Ø 60 HZ 4 WIRE

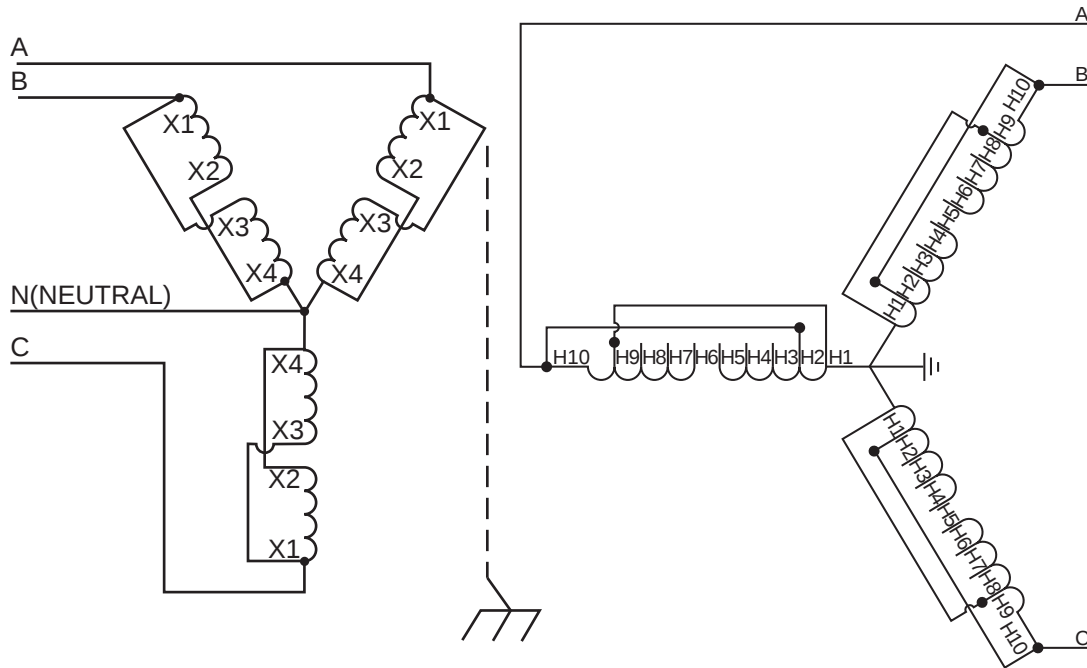

OUTPUT 374Y/216 VOLTS 3Ø 60 HZ 4 WIRE

| CATALOG NO.  | 1Ø KVA | 3Ø KVA | QTY. |
|--------------|--------|--------|------|
| T-2-53515-3S | 7.5    | 22.5   | 3    |
| T-2-53516-3S | 10     | 30     | 3    |
| T-2-53517-3S | 15     | 45     | 3    |
| T-2-53518-3S | 25     | 75     | 3    |

NOTE – PRIMARY NEUTRAL MUST BE CONNECTED TO TRANSFORMER BANK.

INPUT AND OUTPUT CAN BE REVERSE CONNECTED.



**Acme Electric  
Corporation**

Power Distribution Products Division

4815 West Fifth Street  
Lumberton, NC 28358  
910-738-1121 Inside NC  
800-334-5214 Outside NC  
910-739-0024 Fax  
[www.acmepowerdist.com](http://www.acmepowerdist.com)

A-125883